

#### INFLOW DESIGN FLOOD CONTROL SYSTEM PLAN LINCOLN STONE QUARRY JOLIET 9 STATION OCTOBER 2021

Pursuant to Code of Federal Regulations Title 40, Part 257, Subpart D (40 CFR), herein referred to as the coal combustion residual (CCR) Rule, §257.82(c), Geosyntec Consultants, Inc. (Geosyntec) prepared this Inflow Design Flood Control System Plan for the CCR surface impoundment referred to as the Lincoln Stone Quarry (Quarry) at the Joliet 9 Station (Site) in Joliet, Illinois. The Quarry is leased and operated by Midwest Generation, LLC (Midwest Generation).

Section 257.82(c) of the CCR Rule requires that operators of every existing or new CCR surface impoundment design, construct, operate, and maintain an inflow design flood control system plan that adequately manages flow into the CCR unit during and following the peak discharge of the inflow design flood. The Preamble of the CCR Rule provides guidance on the documentation that should be provided for the inflow design flood control system plan.

An Inflow Design Flood Control System Plan for the Quarry meeting the requirements of \$257.82(c) was completed in October 2016. This Inflow Design Flood Control System Plan is being completed in accordance with \$257.82(c)(4) which requires the plan be updated every five years. The inflow design flood control system consists of an outflow pipe and maintaining minimum operating freeboard. Justification and documentation of the adequacy of the inflow design flood control systems are presented in the sections below.

The work presented in this report was performed under the direction of Ms. Olivia Covert, of Geosyntec in accordance with §257.82(c). Mr. Jesse Varsho, P.E. reviewed this plan in accordance with Geosyntec's senior review policy.

# 1. Quarry Design

The Quarry is located east of the Site's former coal pile and approximately 1,000 feet south of the Des Plaines River. The Quarry is bounded on the north by Patterson Road and on the east by Brandon Road. The Quarry is considered incised in accordance with the CCR regulations (Geosyntec, 2021) and is bounded on the north, south, and east boundaries by cut slopes. The western portion of the Quarry, referred to as the West Filled Area, has been backfilled to existing adjacent grades and capped. Prior to the conversion of the Joliet 9 Station to natural gas in spring 2016, the Quarry received sluiced CCR from Joliet Units 6, 7, and 8, through a piping system that discharged into the southwest corner (Units 7 and 8) and the northwest corner (Unit 6) of the

Quarry. The Quarry stopped receiving CCR in 2019; therefore, rainfall and storm water runoff from the farmland and wooded area to the south are the only sources of discharge to the Quarry. Discharge of water from the Quarry is controlled through two pipes that gravity drain to a quarry located north of Patterson Road which is then discharged to the Des Plaines River. The invert elevation of these pipes is approximately 527 feet Mean Sea Level (ft MSL), above the ash accumulation level in that area of the Quarry. Gate valves on the outlet pipes are controlled manually by Midwest Generation staff to comply with the Quarry's Bureau of Land Permit No. 1994-241-LFM requirement that local groundwater gradients flow from east to west and from south to north.

# 2. Inflow Design Flood Control System Plan Documentation

Because of the operating procedures and incised condition of the Quarry, some of the references and drawings recommended for inclusion in the Inflow Design Flood Control System Plan by the Preamble to the CCR Rule (page 21392) are not applicable. Table 1 below provides a summary of this documentation.

Documentation	Assessment				
Identification of the design storm event	Identification of the design storm event is provided in Section 3. A drawing of the Quarry and catchment area is presented				
for the catchment area and CCR unit	in Figure 1.				
Characterization of the rainfall abstractions, including but not limited to depression storage and infiltration in the upstream catchment area and selection of the appropriate run-off model	The selected run-off model and upstream catchment area assumptions are provided in <b>Appendix A</b> .				
Identification and characterization of and intake or decant structures	Outflow pipes are described in Section 1. Because there is sufficient freeboard in the Quarry to prevent overflow during the design event, as described in Section 6, capacity of outflow pipes is not evaluated.				
Appropriate characterization and capacity of spillways	The Quarry does include a spillway.				
Characterization of downstream hydraulic structures	Because there is sufficient freeboard in the Quarry to prevent overflow during the design event, as described in Section 6, characterization of downstream structures is not required.				

**Table 1: Recommended Documentation** 

# 3. Design Event

As the Quarry is considered incised in accordance with the CCR regulations (Geosyntec, 2021), the inflow design flood is the 25-year flood in accordance with Section 257.82(a)(3). Flood flows are typically established by performing statistical analysis on historical stream gauge records. In instances where measured stream flow records are not available, deterministic methods such as a design storm method (ASCE, 1996) is used to establish flood flows. In the design storm method, a rainfall to runoff analysis (e.g., Runoff Curve Number Method) is used to establish the stormwater runoff flows. The underlying assumptions in the design storm method are: 1) rainfall will occur uniformly across the entire contributing watershed; and 2) a specified return period storm event produces the same return period flow (e.g., 25-year storm event produces the 25-year flood). Since there are no measured stream flow records at the Quarry, the design storm method was used to estimate the inflows to the Quarry for the 24-hour, 25-year precipitation event.

# 4. Existing Quarry Water Level

Water accumulates inside the Quarry due to its incised characteristics, and water levels within the Quarry are controlled to meet the Quarry's permitting requirements (see Section 1). Midwest Generation monitors the surface water level within the Quarry daily and controls outflow from the Quarry to influence the localized groundwater gradients. Average daily water level data within the Quarry is shown in **Figure 2** and indicates that the surface water level has been maintained below 548 ft MSL over the last five years. The operating level of the Quarry is assumed to be 548 ft MSL or below. Based on the site topography<sup>1</sup>, the water level within the Quarry could rise to approximately 572 ft MSL before discharging from the Quarry.

# 5. Catchment Area

A description of the area surround ding the Quarry is shown in the following table.

Direction	Land Use
North	Patterson Road, two small quarries, woodland, Des Plaines River.
West	Woodland, heavy industrial site.
South	Grass and farmland, woodland, heavy industrial site.
East	South Brandon Road, low density residential area, inactive quarry,
East	grass and farmland, large active quarry (Southeast)

<sup>&</sup>lt;sup>1</sup> Topography is dated May 2014, generated by Sidwell from Aerial photo taken in 2014.

The catchment area of the Quarry was delineated using topographic maps and images. The catchment area is approximately 89 acres, see Figure 1.

# 6. Analysis of Inflow Design Flow and Storage Capacity

The inflow design flow for the 25-year event was calculated based on runoff associated with the 24-hour, 25-year storm event for the upstream catchment area, which was estimated based on regional topography and the Runoff Curve Number Method. Analysis demonstrating the inflow design flow is included in **Appendix A**. The total inflow into the Quarry during the 24-hour 25-year storm event is estimated to be 38.4 acre-feet. Based on 2021 surface water conditions, the surface area of the impounded water within the Quarry is approximately 12.5 acres. The estimated potential water level increase is calculated to be 3.1 ft from the design event. Therefore, the water level in the Quarry after the design event is estimated to be at or below 552 ft MSL (operating level of 548 ft MSL plus 4 ft).

The freeboard after the design event is estimated to be a minimum of 20 ft (572 ft MSL – 552 ft MSL). As the existing freeboard is estimated to be at least 20 feet, sufficient storage capacity exists within Quarry to manage the inflow from the design flood event. The inflow design system, as designed and constructed, meets the requirements of §257.82.

#### 7. Limitations and Certification

The inflow design flood control system plan meets the requirements of §257.82(c) of the Code of Federal Regulations Title 40, Part 257, Subpart D, and was prepared in accordance with current practices and the standard of care exercised by scientists and engineers performing similar tasks in the field of civil engineering. The contents of this report are based solely on the observations of the conditions observed by Geosyntec personnel and information provided to Geosyntec by Midwest Generation. Consistent with applicable professional standards of care, our opinions and recommendations were based in part on data furnished by others, which was consistent with other information that we developed in the course of our performance of the scope of services. The information contained in this report is intended for use solely by Midwest Generation and their subconsultants.



Op Ul

Jesse P. Varsho, P.E. Illinois Professional Engineer No. 062.059069 License Expires: November 30, 2021

### 8. References

- ASCE, 1996. American Society of Civil Engineers Task Committee on Hydrology Handbook. Hydrology Handbook. ASCE Publications.
- Geosyntec Consultants, 2021, Lincoln Stone Quarry Site Visit, CCR Rule Compliance Demonstrations, Midwest Generation LLC Power Stations, Illinois, dated 31 August.

Attachments

Figure 1:	Catchment Area
Figure 2:	Quarry Water Level
Appendix A:	Stormwater Run-on Calculations

5

Figures




Aerial imagery from ArcGIS Online, September 2021.Topography based on May 2014 topography provided by KPRG.

Project No: GLW8016 L \\chicago-01\data\DWG\N\NRG\LSQ\IDFCP\2021 Plan\GIS\MXDs\20210915\_Lincoln Stone Quarry.mxd. ASoltero. 9/16/2021. Project/Phase/Task.

1

September 2021

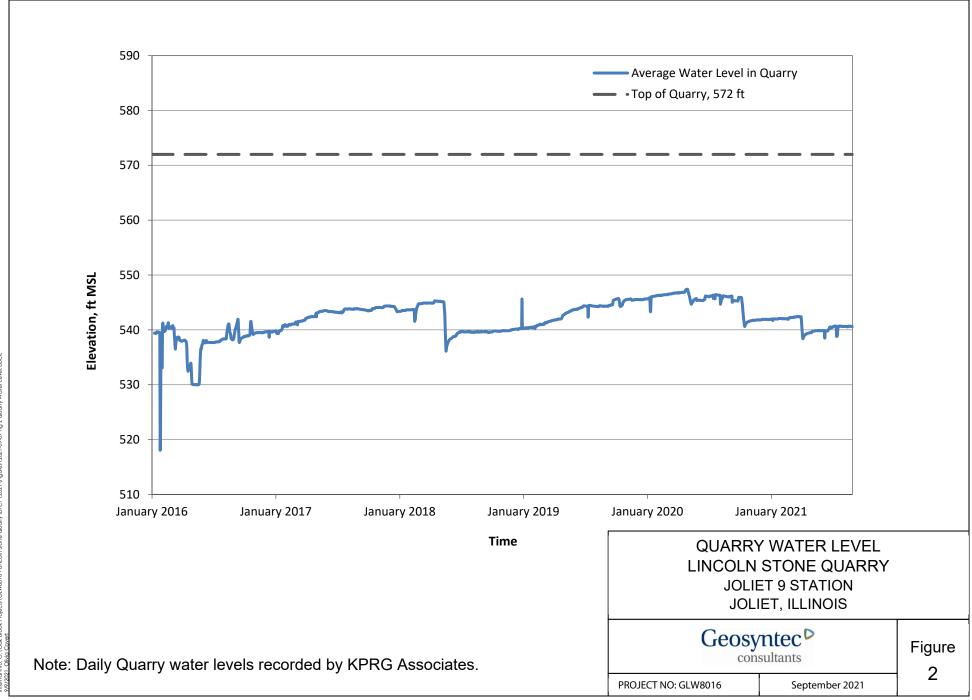

Appendix A

Stormwater Run-on Calculations

# Geosyntec consultants

# **COMPUTATION COVER SHEET**

Client:	Midwest Generation	Project:	Joliet 9 Station	Project/ Proposal No.: <u>GLW8016</u> Task No.
Title of Co	omputations		AWATER RUN-ON CALCUI E QUARRY	LATIONS, LINCOLN
Computati	ions by:	Signature	Ofini Cond	20 September 2021
	-	Printed Name	Olivia Covert	Date
	-	Title	Professional	
Assumptic Procedures by:	ons and s Checked	Signature	Reglan	27 September 2021
(peer revie	ewer)	Printed Name	Regan Welch	Date
	-	Title	Project Engineer	
Computati Checked b		Signature	Reglan	27 September 2021
	-	Printed Name	Regan Welch	Date
	-	Title	Project Engineer	
Computati backcheck	ted by:	Signature	Olii Coul	27 September 2021
(originator	r) –	Printed Name	Olivia Covert	Date
	-	Title	Professional	
Approved		Signature	a all	29 September 2021
(pm or des	signate)	Printed Name	Jesse Varsho, P.E.	Date
	-	Title	Principal Engineer	
Approval	notes:			
Revisions	(number and in	iitial all revisions	)	

				(	•	/ <b>ntec</b>
				Page	2	of <u>6</u>
Written by: OC	Date:	20 / 09 / 21 DD MM YY	Reviewed by:	RW	Date:	27 / 09 /2021 DD MM YY
Client: Midwest Generation	Project:	Joliet 9	Project/Prop No.:	GLW8016	Task No.:	1

# STORMWATER RUN-ON CALCULATIONS LINCOLN STONE QUARRY JOLIET 9 STATION

#### INTRODUCTION

Pursuant to Code of Federal Regulations Title 40, Part 257, Subpart D, (40 CFR) Section 257.82(c), Geosyntec Consultants, Inc. (Geosyntec) prepared this calculation package to support development of the Inflow Design Flood Control System Plan for the Lincoln Stone Quarry (Quarry) at the Joliet 9 Station (Site) in Joliet, Illinois. 40 CFR Section 257.82(c) requires that operators of every existing or new CCR (Coal Combustion Residuals) surface impoundment design, construct, operate, and maintain an inflow design flood control system that adequately manages flow into the CCR unit during and following the peak discharge of the inflow design flood. This calculation evaluates the inflow design flood and evaluates the capacity of the Quarry to handle inflow from this event.

#### CALCULATION OF INFLOW DESIGN FLOW

The City of Joliet's "Consolidated Stormwater Management, Soil Erosion and Sediment Control and Floodplain Management Regulations specifies that the Soil Conservation Service (SCS) Runoff Curve Number Method be used to calculate design runoff volumes. The SCS method and its current application are documented in Technical Release 55 (TR-55) published by Natural Resources Conservation Service (NRCS). The SCS runoff equation is:

$$Q = \frac{(P - I_a)^2}{(P - I_a) + S}$$

Where:

Q = runoff(in)

P = rainfall (in)

S = potential maximum retention after runoff begins (in) and

 $I_a = initial abstraction (in)$ 

				(		sultants
				Page	3	of <u>6</u>
Written by: OC	Date:	20 / 09 / 21 DD MM YY	Reviewed by:	RW	Date:	27 / 09 /2021 DD MM YY
Client: Midwest Generation	Project:	Joliet 9	Project/Prop No.:	GLW8016	Task No.:	1

Coogentoop

The initial abstraction ( $I_a$ ) accounts for all losses prior to the beginning of runoff including water retained in surface depressions, intercepted by vegetation, evaporation, and infiltration.  $I_a$  is typically correlated with soil cover parameters and is approximated by the equation:

$$I_a = 0.2S$$

S is a function of the soil type and cover and is related to the runoff curve number (CN) by the equation:

$$S = \frac{1000}{CN} - 10$$

Where:

CN = Runoff Curve Number

CN is determined by the Hydrologic Soils Group (HSG) and cover type, treatment, hydrologic condition, and antecedent moisture condition. In cases where multiple land uses occur in the same drainage area, a composite CN is determined by the area weighted method.

After calculating runoff (Q) for a design storm event, the total volume of runoff is then calculated by multiplying the runoff by the drainage area (A).

# DRAINAGE AREA (A)

The area of the drainage basin of the Quarry was delineated using topographic maps<sup>1</sup> and aerial images<sup>2</sup>. The catchment area has an estimated area of 89.2 acres (refer to Figure 1), and was subdivided into four areas based on land use (cover) and soil type (HSG) for determination of CN. The catchment area outside of the Quarry footprint is located to the south.

<sup>&</sup>lt;sup>1</sup> Topography is dated May 2014, generated by Sidwell from Aerial photo taken in 2014.

<sup>&</sup>lt;sup>2</sup> ESRI ArcGIS online images accessed in September 2021. Imagery credit: ESRI

				(		sultants
				Page	4	of <u>6</u>
Written by: OC	Date:	20 / 09 / 21 DD MM YY	Reviewed by:	RW	Date:	27 / 09 /2021 DD MM YY
Client: Midwest Generation	Project:	Joliet 9	Project/Prop No.:	GLW8016	Task No.:	

Coogentoop

# **RUNOFF CURVE NUMBER (CN)**

The value of the runoff curve number (CN) has been extensively studied in the literature. Its value depends on the land use and type of soil (HSG). In general, the value of CN is higher for developed, impervious surfaces, and Type D soils. Correspondingly, CN has lower values for undeveloped pervious surfaces, and Type A soils.

Land use in the drainage basin within the Quarry is mostly rock or standing water. Land use in the drainage basin outside of the Quarry is mostly pasture, grass and farmland. Industrial sites to the south and east of the Quarry are located outside the drainage basin.

HSG for use in CN selection was determined by importing the watershed boundary into the Natural Resources Conservation Service Web Soil Survey (Attachment A). Approximately 0.5% of the site consists of vegetated Type B soils, 45.2% of the site consists of vegetated Type C soils, 11.4% vegetated Type D soils, 42.9% water. Based on the HSG and land use analysis a composite CN of 88.5 was determined for the drainage area. The following table summarized the analysis of the runoff curve number.

Description	Area (acres)	HSG	Cover Type	CN	Weighted
Pond	38.3	W	Water	100	42.9
Vegetated	0.4	В	Open Space-Fair	69	0.3
Vegetated	40.3	С	Open Space-Fair	79	35.7
Vegetated	10.2	D	Open Space-Fair	84	9.6
Total	89.2 acres		Cor	nposite	88.5

# **RAINFALL DEPTH (P)**

In accordance with 40 CR Section 257.82(a)(3)(iv), the inflow design flood for an incised CCR surface impoundment, such as the Quarry, is the 25-year flood.

The City of Joliet requires the use of the Illinois State Water Survey Bulletin 70, Northeast Sectional rainfall statistics. Will County requires the use of the Illinois State Water Survey Updated Bulletin 70, Northeast Sectional Code (Angel and Marcus, 2019) in runoff volume calculations. The 1989 Bulletin 70 has a 25-year, 24-hour rainfall depth of 6.04 inches and the Updated Bulletin 70 has a higher 25-year, 24-hour rainfall depth (6.45 inches). Therefore, the Updated Bulletin 70 publication value was used in the calculations for the Quarry.

				(	•	/ntec <sup>▷</sup> nsultants
				Page	5	of <u>6</u>
Written by: OC	Date:	20 / 09 / 21 DD MM YY	Reviewed by:	RW	Date:	27 / 09 /2021 DD MM YY
Client: Midwest Generation	Project:	Joliet 9	Project/Prop No.:	GLW8016	Task No.:	1

### **INFLOW DESIGN FLOW**

The following table summarizes the inflow design flow calculations.

Parameter	25-Year, 24-Hour Precipitation Event
CN	88.5
S	1.3
Р	6.5
Ia	0.3
Q (in)	5.2
Area (Ac)	89.2
Volume (ac-ft)	38.4

The potential increase in Quarry water surface elevation was estimated by dividing the total inflow (38.4 acre-ft for the design event) by the Quarry wet area (estimated to be 12.5 acres based on 2021 aerial images). The increase in water depth in the Quarry for the design event is approximately 3.1 ft.

#### WATER LEVEL AND FREEBOARD

Water accumulates inside the Quarry due to its incised characteristics, and water levels within the Quarry are controlled to meet the Quarry's Bureau of Land Permit No. 1994-241-LFM requirement that local groundwater gradients flow from east to west and from south to north. Midwest Generation monitors the surface water level within the Quarry daily and implements engineering controls to influence the localized groundwater gradients. Average daily water level data within the Quarry indicates that the surface water level has been maintained below 548 feet mean seal level (ft MSL) over the last five years (Figure 2). The water surface elevation for the design event, assuming the water level is at 548 ft prior to the start of the design event, is 552 ft.

Based on the site topography<sup>3</sup>, the water level within the Quarry could rise to approximately 572 ft MSL before discharging. The freeboard after the design event is estimated to be at least 20 ft (572 ft MSL – 552 ft MSL). As the existing freeboard is

<sup>&</sup>lt;sup>3</sup> Topography is dated May 2014, generated by Sidwell from Aerial photo taken in 2014.

					cons		
				Page	6	of <u>6</u>	
Written by: OC	Date:	20 / 09 / 21 DD MM YY	Reviewed by:	RW	Date:	27 / 09 /2021 DD MM YY	
Client: Midwest Generation	Project:	Joliet 9	Project/Prop No.:	GLW8016	Task No.:	1	

Ceosyntec

estimated to be 20 feet (minimum), sufficient storage capacity exists within Quarry to manage the design flood event without discharge.

#### **1. REFERENCES**

- City of Joliet, 2003, Consolidated Storm Water Management, Soil Erosion and Sediment Control and Floodplain Management Regulations.
- Angel, James, and Markus, Momcilo, March 2019. Frequency Distributions of Heavy Precipitation in Illinois: Updated Bulletin 70 (Updated Bulletin 70, Illinois State Water Survey).
- Technical Release 55 (TR-55), Natural Resources Conservation Service, USDA, 2016, Soil Map, Will County, Illinois, Web Soil Survey, National Cooperative Soil Survey. USDA Natural Resources Conservation Service.
- Water Resource Ordinance for Unincorporated Will County.

#### ATTACHMENTS


Attachment A: Soil Map from USDA – Natural Resources Conservation Service

Attachment B: Illinois State Water Survey Updated Bulletin 70




Attachment A

Soil Map from USDA – Natural Resources Conservation Service

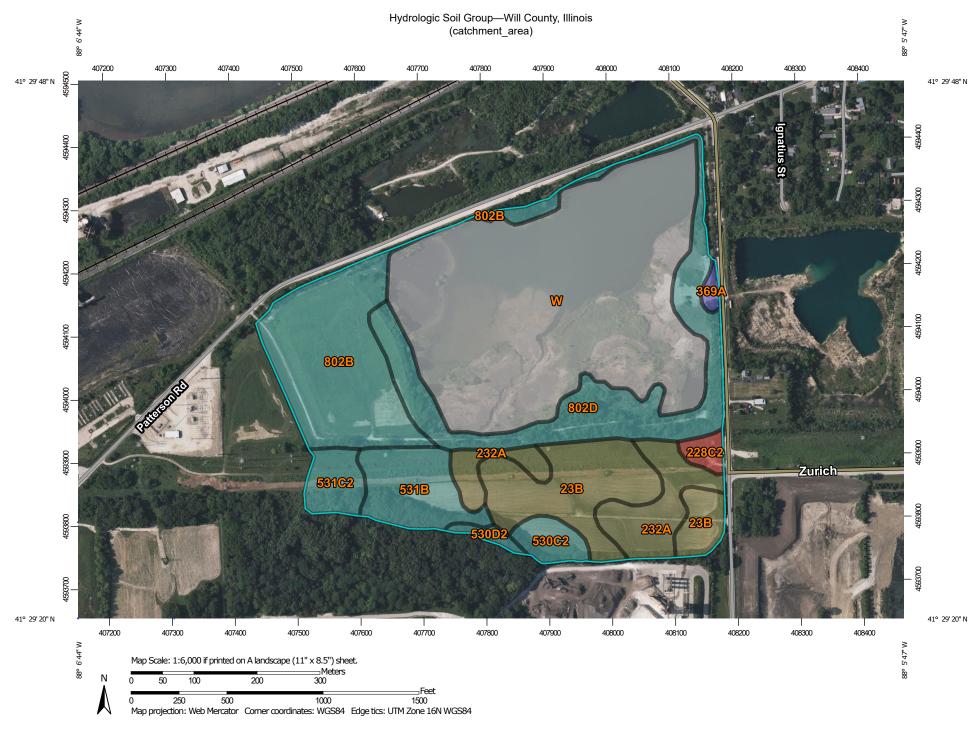

USDA Natural Resources Conservation Service Web Soil Survey National Cooperative Soil Survey

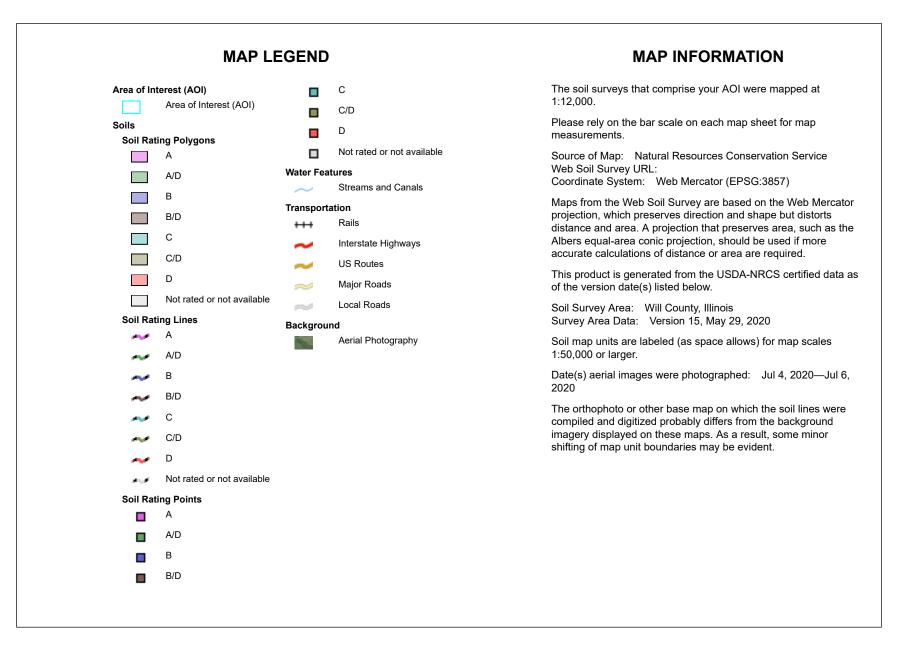

# Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
23B	Blount silt loam, Lake Michigan Lobe, 2 to 4 percent slopes	C/D	9.4	10.5%
228C2	Nappanee silty clay loam, 4 to 6 percent slopes, eroded	D	0.8	0.9%
232A	Ashkum silty clay loam, 0 to 2 percent slopes	C/D	6.0	6.7%
369A	Waupecan silt loam, 0 to 2 percent slopes	В	0.4	0.5%
530C2	Ozaukee silt loam, 4 to 6 percent slopes, eroded	С	1.7	1.9%
530D2	Ozaukee silt loam, 6 to 12 percent slopes, eroded	С	0.6	0.6%
531B	Markham silt loam, 2 to 4 percent slopes	С	4.9	5.5%
531C2	Markham silt loam, 4 to 6 percent slopes, eroded	С	2.2	2.5%
802B	Orthents, loamy, undulating	С	12.6	14.2%
802D	Orthents, loamy, rolling	С	12.3	13.8%
W	Water		38.3	42.9%
Totals for Area of Inter	rest		89.1	100.0%

# Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

# **Rating Options**

Aggregation Method: Dominant Condition Component Percent Cutoff: None Specified Tie-break Rule: Higher



Attachment B Illinois State Water Survey Updated Bulletin 70

# Frequency Distributions of Heavy Precipitation in Illinois: Updated Bulletin 70

James Angel and Momcilo Markus

March 2019

**ILLINOIS** Illinois State Water Survey PRAIRIE RESEARCH INSTITUTE

# Results

#### **Frequency Estimates**

To determine the precipitation frequency, the previously described regional frequency analysis was applied to the AMS data. The results were then converted to the PDS domain based on the relationship defined in Eq. 1 and adjusted for the trend (Eq. 3). These results, however, still had occasional minor inconsistencies caused by several factors, such as variable data length for different durations, which resulted in irregular frequency curves. To produce the final curves, these irregularities had to be smoothed out, which was done based on the authors' professional judgment and knowledge of specific regions and gages.

The results for all sections are shown in the following tables. Table 4 displays the key for the codes used in Table 5, where the results are presented numerically. The results are shown graphically in Figures 8–12.

Storm Code		Sectional Code			
1	240 hours	1	Northwest		
2	120 hours	2	Northeast		
3	72 hours	3	West		
4	48 hours	4	Central		
5	24 hours	5	East		
6	18 hours	6	West Southwest		
7	12 hours	7	East Southeast		
8	6 hours	8	Southwest		
9	3 hours	9	Southeast		
10	2 hours	10	South		
11	1 hour				

Table 4 Storm and Sectional Codes for Table 5

Rainfall (inches) for given recurrence interval									
Storm	Section	2-year	5-year	10-year	25-year	50-year	100-	500-	
code	code						year	year	
4	1	3.61	4.59	5.43	6.72	7.73	8.83	11.53	
4	2	3.66	4.71	5.62	6.99	8.13	9.28	12.10	
4	3	3.76	4.76	5.62	6.81	7.72	8.60	10.58	
4	4	3.59	4.61	5.47	6.65	7.55	8.40	10.21	
4	5	3.54	4.49	5.32	6.48	7.38	8.27	10.26	
4	6	3.66	4.61	5.38	6.48	7.33	8.11	9.93	
4	7	3.92	4.85	5.61	6.67	7.46	8.21	9.76	
4	8	4.28	5.29	6.10	7.25	8.15	9.08	11.40	
4	9	4.64	5.54	6.27	7.24	7.94	8.58	10.06	
4	10	4.06	5.02	5.86	7.04	8.01	9.02	11.56	
5	1	3.34	4.22	5.03	6.20	7.20	8.25	10.84	
5	2	3.34	4.30	5.15	6.45	7.50	8.57	11.24	
5	3	3.48	4.45	5.24	6.38	7.25	8.06	9.91	
5	4	3.32	4.30	5.10	6.20	7.05	7.85	9.53	
5	5	3.12	3.97	4.71	5.78	6.62	7.43	9.32	
5	6	3.23	4.07	4.76	5.79	6.56	7.31	9.04	
5	7	3.49	4.33	5.00	5.98	6.71	7.40	8.84	
5	8	3.69	4.56	5.27	6.30	7.14	7.96	10.06	
5	9	4.07	4.89	5.55	6.42	7.06	7.68	8.99	
5	10	3.63	4.52	5.28	6.38	7.29	8.23	10.57	
6	1	3.14	3.97	4.73	5.83	6.77	7.75	10.19	
6	2	3.14	4.04	4.84	6.06	7.05	8.06	10.57	
6	3	3.27	4.18	4.93	6.00	6.82	7.58	9.32	
6	4	3.12	4.04	4.79	5.83	6.63	7.38	8.96	
6	5	2.93	3.73	4.43	5.43	6.22	6.98	8.76	
6	6	3.04	3.83	4.47	5.44	6.17	6.87	8.50	
6	7	3.28	4.07	4.70	5.62	6.31	6.96	8.31	
6	8	3.47	4.29	4.95	5.92	6.71	7.48	9.45	
6	9	3.83	4.60	5.22	6.03	6.64	7.22	8.45	
6	10	3.41	4.25	4.96	6.00	6.85	7.73	9.93	

#### Rainfall (inches) for given recurrence interval

Storm Code	Section Code	Recurrence interval							
		2-year	5-year	10-year	25-year	50-year	100-year	500-year	
5	1	3.34	4.22	5.03	6.20	7.20	8.25	10.84	
		( 3.00 -	( 3.79 -	( 4.50 -	( 5.51 -	( 6.34 -	( 7.20 -	( 9.16 -	
		3.69)	4.68)	5.61)	6.99)	8.21)	9.54)	13.00)	
5	2	3.34	4.30	5.15	6.45	7.50	8.57	11.24	
		( 3.00 -	( 3.85 -	( 4.60 -	(5.71 -	( 6.59 -	( 7.46 -	( 9.48 -	
		3.69)	4.77)	5.73)	7.26)	8.55)	9.93)	13.63)	
5	3	3.48	4.45	5.24	6.38	7.25	8.06	9.91	
		( 3.19 -	( 4.07 -	( 4.79 -	( 5.81 -	( 6.56 -	( 7.23 -	( 8.61 -	
		3.79)	4.86)	5.74)	7.05)	8.09)	9.07)	11.47)	
5	4	3.32	4.30	5.10	6.20	7.05	7.85	9.53	
		( 3.01 -	( 3.89 -	( 4.61 -	( 5.58 -	( 6.31 -	( 6.99 -	( 8.31 -	
		3.65)	4.74)	5.64)	6.91)	7.93)	8.92)	11.16)	
5	5	3.12	3.97	4.71	5.78	6.62	7.43	9.32	
		( 2.86 -	( 3.64 -	( 4.30 -	( 5.25 -	( 5.97 -	( 6.63 -	( 8.08 -	
		3.38)	4.31)	5.15)	6.38)	7.39)	8.41)	10.96)	
5	6	3.23	4.07	4.76	5.79	6.56	7.31	9.04	
		( 2.95 -	( 3.71 -	( 4.32 -	( 5.21 -	( 5.85 -	( 6.45 -	( 7.73 -	
		3.54)	4.47)	5.26)	6.45)	7.37)	8.30)	10.59)	
5	7	3.49	4.33	5.00	5.98	6.71	7.40	8.84	
		( 3.18 -	( 3.93 -	( 4.53 -	( 5.39 -	( 6.00 -	( 6.54 -	( 7.58 -	
		3.80)	4.74)	5.50)	6.64)	7.54)	8.42)	10.44)	
5	8	3.69	4.56	5.27	6.3	7.14	7.96	10.06	
		( 3.36 -	( 4.15 -	( 4.78 -	( 5.67 -	( 6.37 -	( 7.03 -	( 8.60 -	
		4.04)	5.01)	5.82)	7.03)	8.03)	9.05)	11.78)	
5	9	4.07	4.89	5.55	6.42	7.06	7.68	8.99	
		( 3.71 -	( 4.45 -	( 5.03 -	( 5.79 -	( 6.32 -	( 6.80 -	( 7.73 -	
		4.44)	5.35)	6.10)	7.12)	7.91)	8.70)	10.51)	
5	10	3.63	4.52	5.28	6.38	7.29	8.23	10.57	
		( 3.29 -	( 4.08 -	( 4.73 -	( 5.66 -	( 6.36 -	( 7.07 -	( 8.67 -	
		4.00)	5.01)	5.88)	7.21)	8.36)	9.59)	13.03)	

Table 6 Precipitation Frequency Estimates (in inches) with 90% Confidence Intervals (continued)